

NOTES:

1. ASSEMBLY MUST BE TESTED BY A CERTIFIED TESTER UPON COMPLETION OF INSTALLATION.
2. FOR INSTALLATION IN A BASEMENT OR AGAINST A WALL CONTACT THE CITY'S CROSS-CONNECTION COORDINATOR.
3. AS OF 2010, NEW BACKFLOW INSTALLATIONS OR REPLACEMENT MUST BE LEAD-FREE.
4. ASSEMBLY MUST BE APPROVED BY THE FOUNDATION FOR CROSS CONNECTION CONTROL AND HYDRAULIC RESEARCH AT THE UNIVERSITY OF SOUTHERN CALIFORNIA.
5. BACKFLOW PREVENTION DEVICES SHALL BE INSTALLED IN A MANNER PRESCRIBED IN SECTION 7603. TITLE 22 OF THE CALIFORNIA ADMINISTRATIVE CODE.
6. NO BACKFLOW DEVICE SHALL BE REMOVED WITHOUT PRIOR APPROVAL FROM THE CITY OF BRAWLEY.



CITY OF BRAWLEY

DEPARTMENT OF PUBLIC WORKS

TITLE:

BACKFLOW ASSEMBLY
INSTALLATION GUIDELINES

SCALE:

N.T.S.

STD. DWG. NO.


B-6

*REDUCED PRESSURE PRINCIPLE
ASSEMBLY (RP)

APPROVED CITY ENGINEER / YAZMIN ARELLANO, P.E.

DATE

10/23/2012

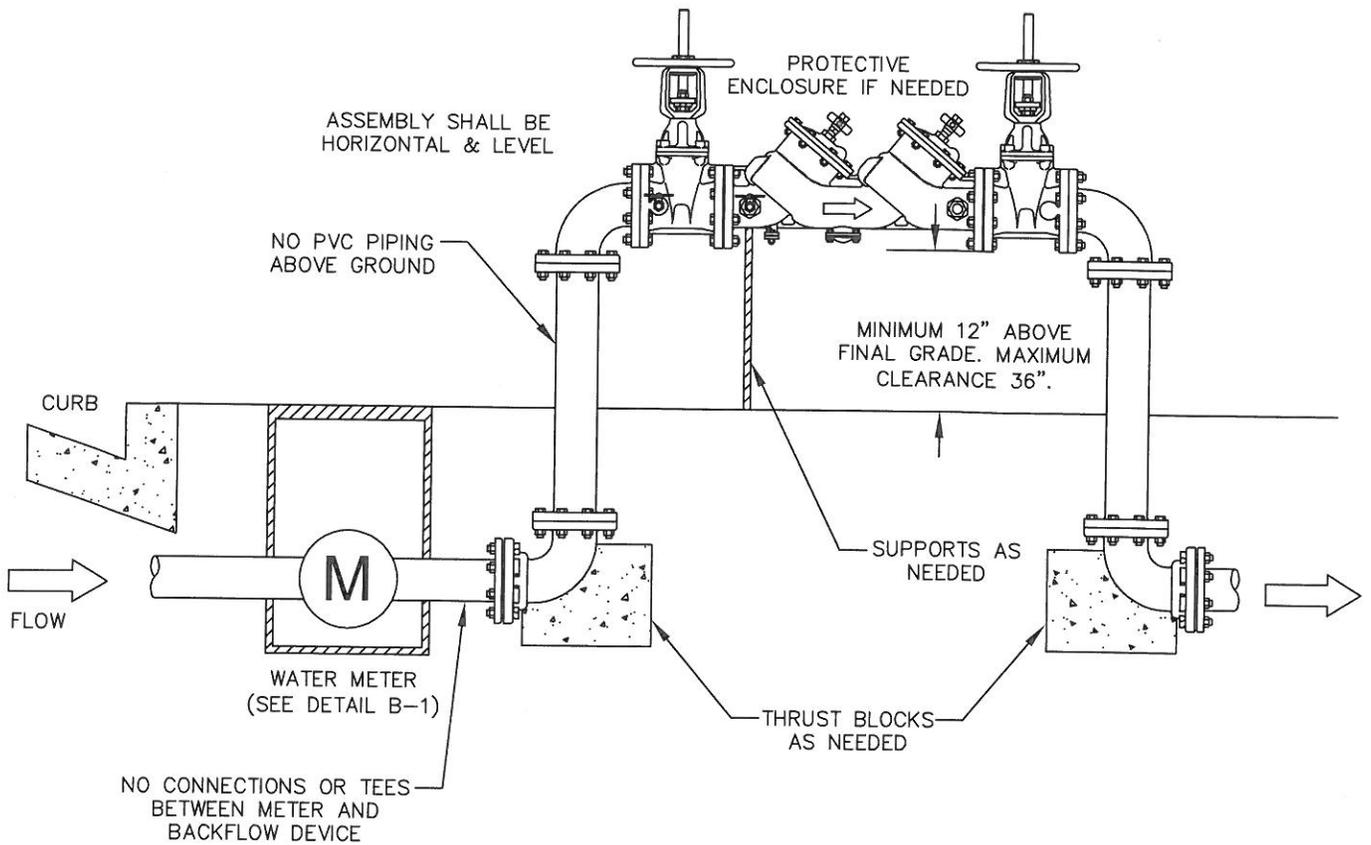

NOTES:

1. ASSEMBLY MUST BE TESTED BY A CERTIFIED TESTER UPON COMPLETION OF INSTALLATION.
2. FOR INSTALLATION IN A BASEMENT OR AGAINST A WALL CONTACT THE CITY'S CROSS-CONNECTION COORDINATOR.
3. AS OF 2010, NEW BACKFLOW INSTALLATIONS OR REPLACEMENT MUST BE LEAD-FREE.
4. ASSEMBLY MUST BE APPROVED BY THE FOUNDATION FOR CROSS CONNECTION CONTROL AND HYDRAULIC RESEARCH AT THE UNIVERSITY OF SOUTHERN CALIFORNIA.
5. BACKFLOW PREVENTION DEVICES SHALL BE INSTALLED IN A MANNER PRESCRIBED IN SECTION 7603. TITLE 22 OF THE CALIFORNIA ADMINISTRATIVE CODE.
6. NO BACKFLOW DEVICE SHALL BE REMOVED WITHOUT PRIOR APPROVAL FROM THE CITY OF BRAWLEY.



CITY OF BRAWLEY

DEPARTMENT OF PUBLIC WORKS

TITLE:

BACKFLOW ASSEMBLY
INSTALLATION GUIDELINES

SCALE:

N.T.S.

SEE DWG NO.

B-7

*DOUBLE CHECK ASSEMBLY (DC)

APPROVED CITY ENGINEER / YAZMIN ARELLANO, P.E.

DATE

10/23/2012